




Reticle
Catalogue

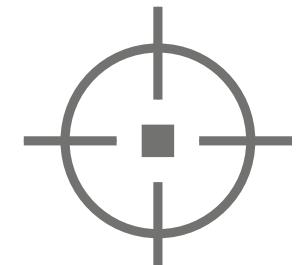

Thermal Imaging Riflescope

THERMION 2 LRF XG50



Non-scalable reticles

The values of the non-scalable reticles are correct in the following cases:

- when the magnification of the scope is set to minimum
- when "picture in picture" is activated



D50i



C50i



X54i



H50i



X50i



T54



M58i



X51Fi-300



M56Fi (Mil-Dot)



M57Fi (Mil-Dot)

Scalable reticles


Reticle parameters apply to all magnifications



D50i



Reticle parameters
(for minimum magnification)

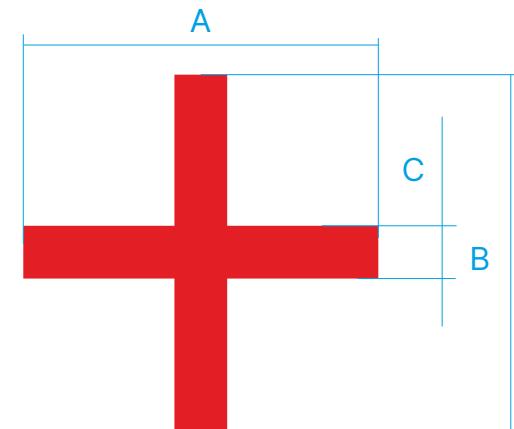

	MOA	cm @ 100 m
Section A	3.6	10.5
Section B	3.6	10.5
Section C	0.5	1.5


Thermal Imaging Riflescope

THERMION 2 LRF XG50


[TO CONTENT](#)



C50i

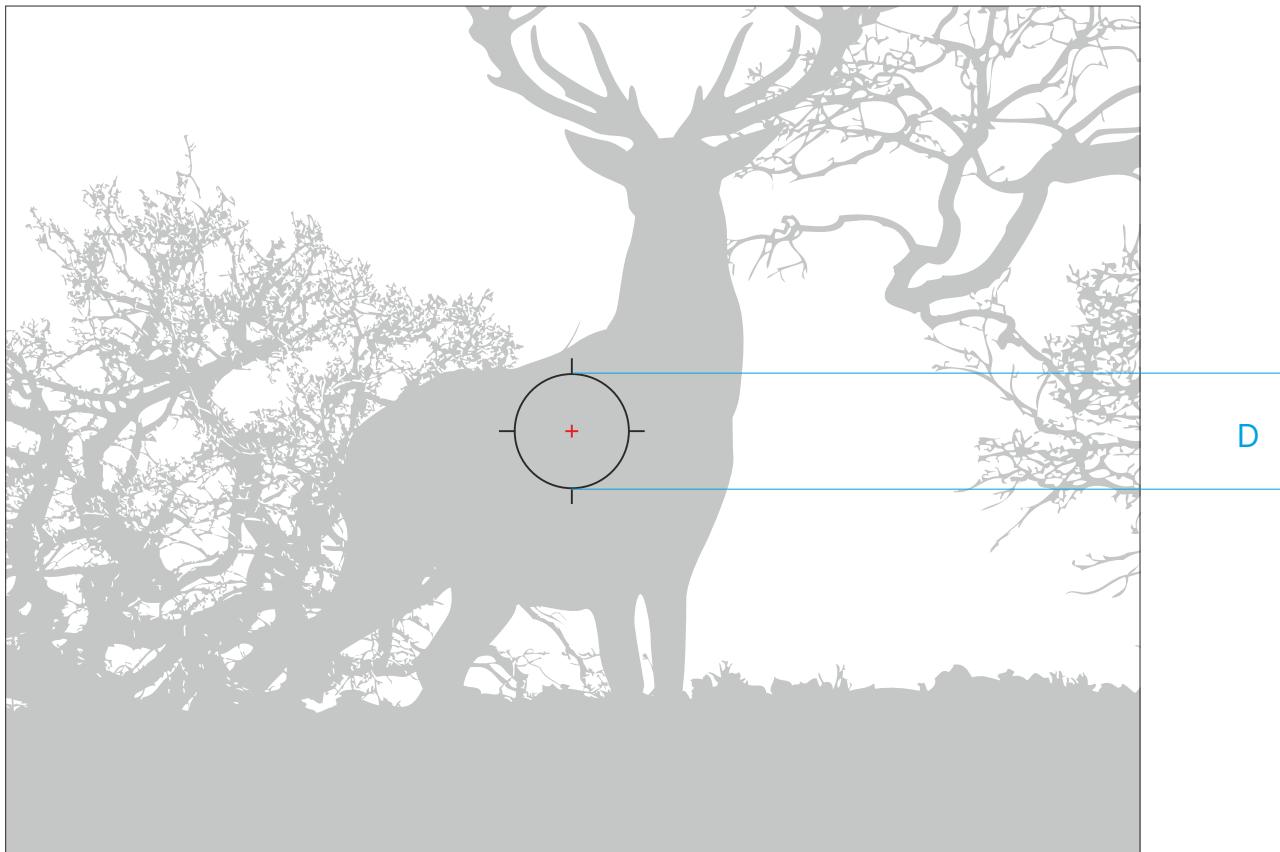

Reticle parameters
(for minimum magnification)

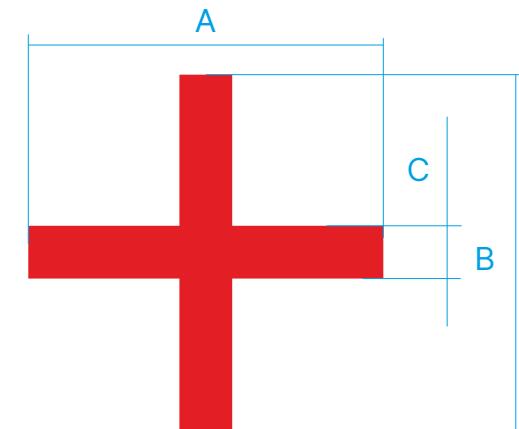

	MOA	cm @ 100 m
Section A	3.6	10.5
Section B	3.6	10.5
Section C	0.5	1.5
Section D	34.4	100


Thermal Imaging Riflescope

THERMION 2 LRF XG50


[TO CONTENT](#)

 **PULSAR**

X54i

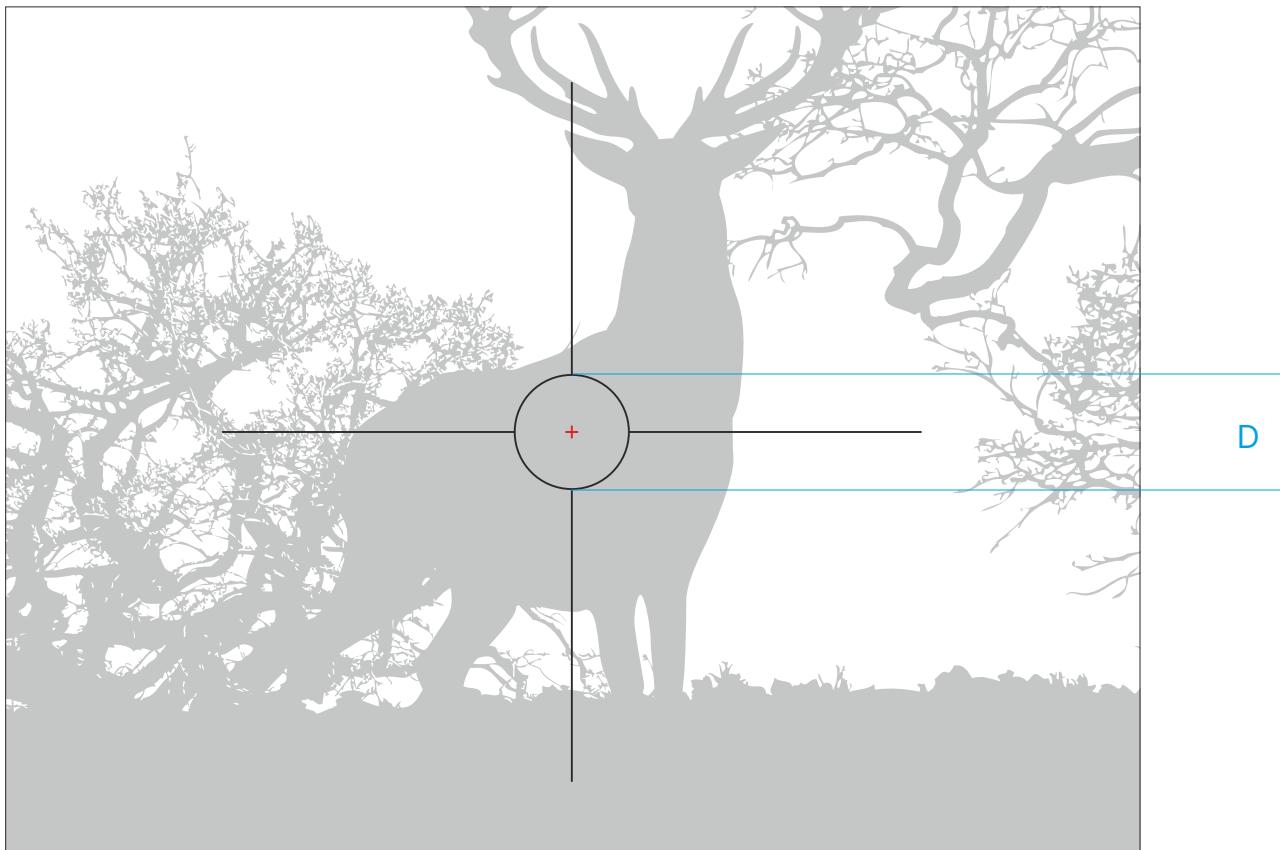

Reticle parameters
(for minimum magnification)

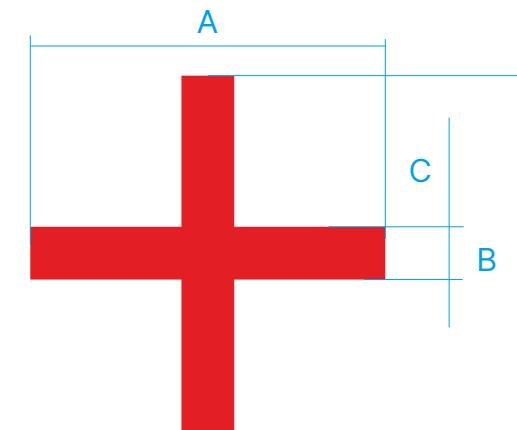

	MOA	cm @ 100 m
Section A	3.6	10.5
Section B	3.6	10.5
Section C	0.5	1.5
Section D	34.4	100


Thermal Imaging Riflescope

THERMION 2 LRF XG50


 **TO CONTENT**



H50i

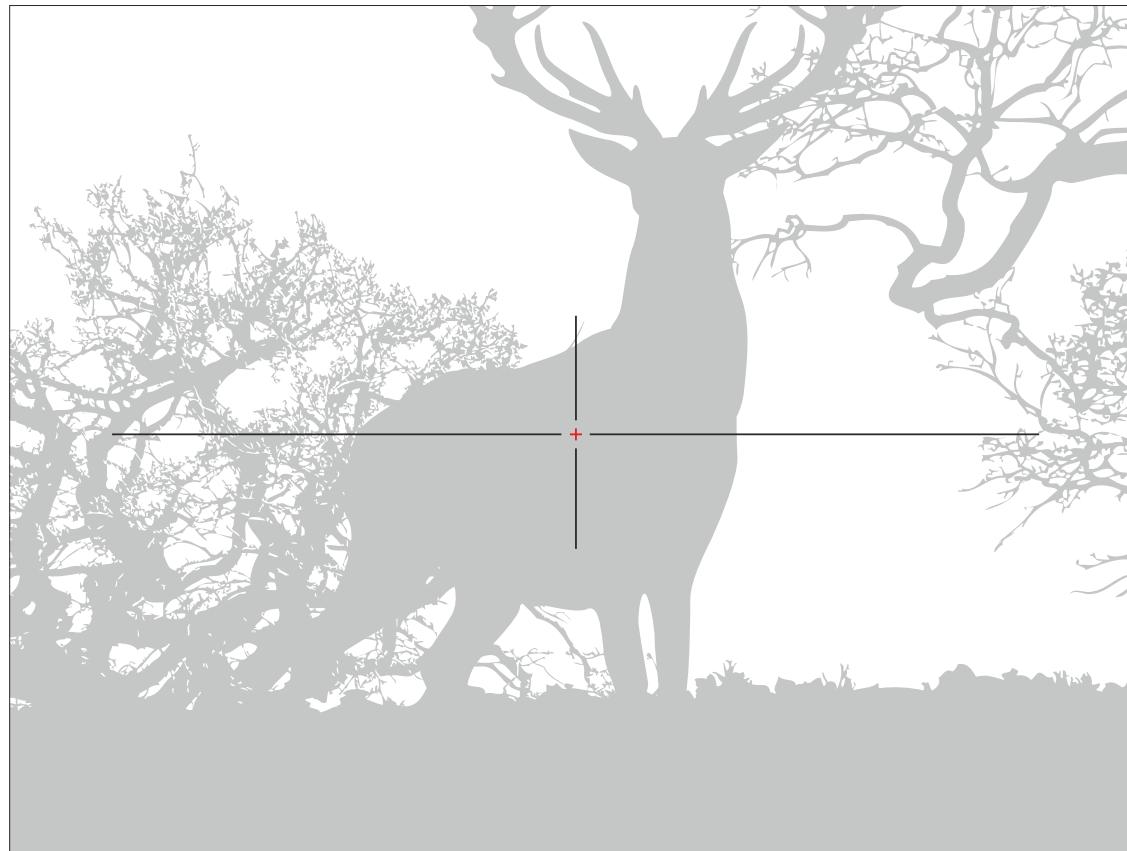

Reticle parameters
(for minimum magnification)

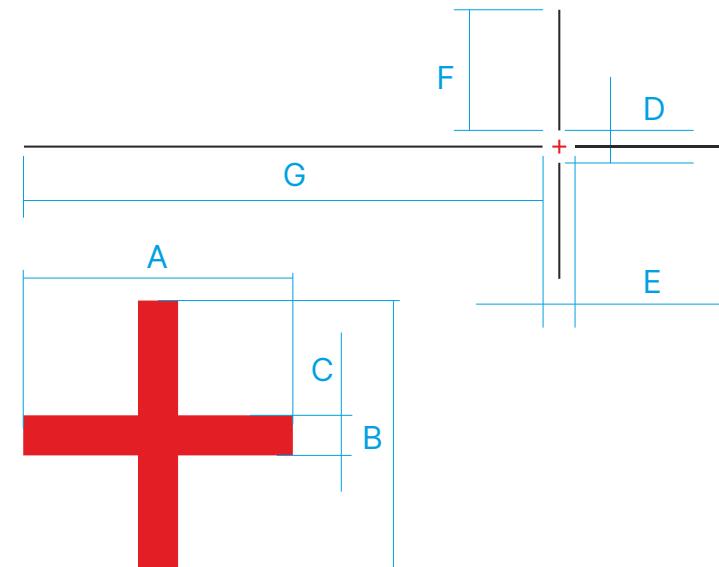

	MOA	cm @ 100 m
Section A	3.6	10.5
Section B	3.6	10.5
Section C	0.5	1.5
Section D	20	58
Section E	20	58
Section F	42	122
Section G	152	442


Thermal Imaging Riflescope

THERMION 2 LRF XG50

[TO CONTENT](#)




X50i

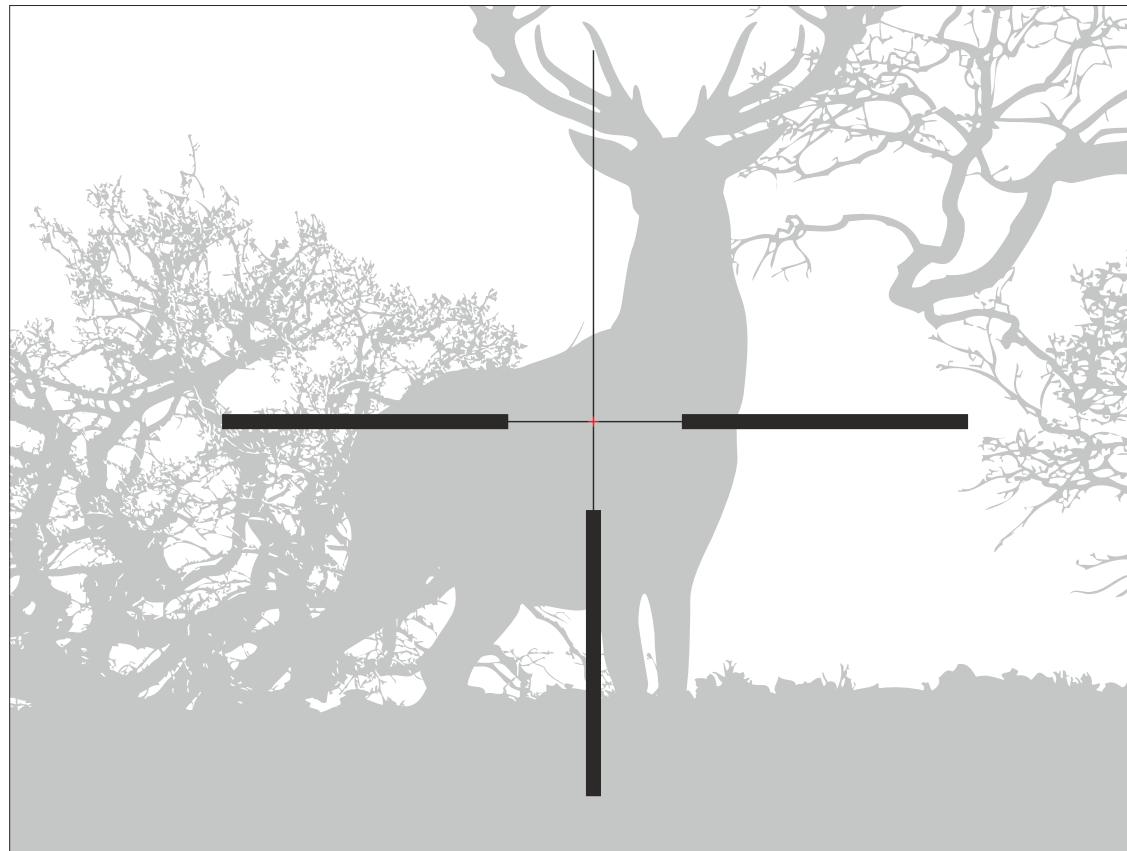

Thermal Imaging Riflescope

THERMION 2 LRF XG50

Reticle parameters
(for minimum magnification)

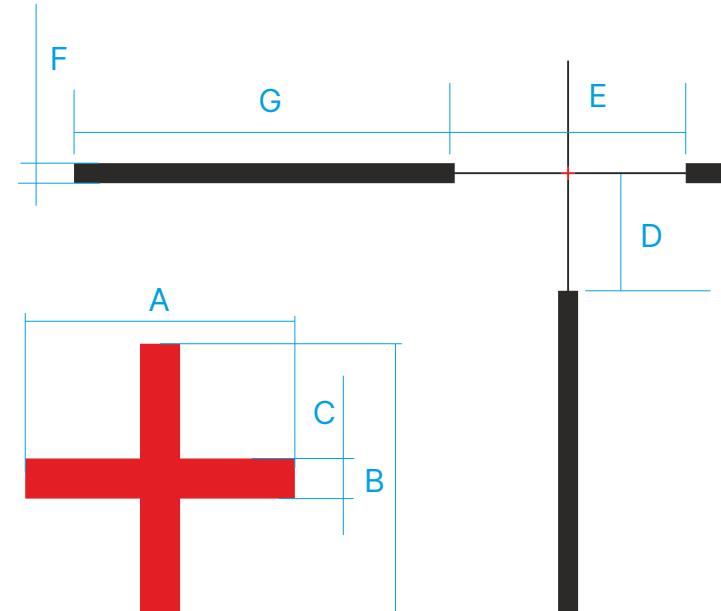

	MOA	cm @ 100 m
Section A	3.6	10.5
Section B	3.6	10.5
Section C	0.5	1.5
Section D	17.2	50
Section E	34.4	100
Section F	1.5	4.4
Section G	145	422


TO CONTENT



T54



Reticle parameters
(for minimum magnification)

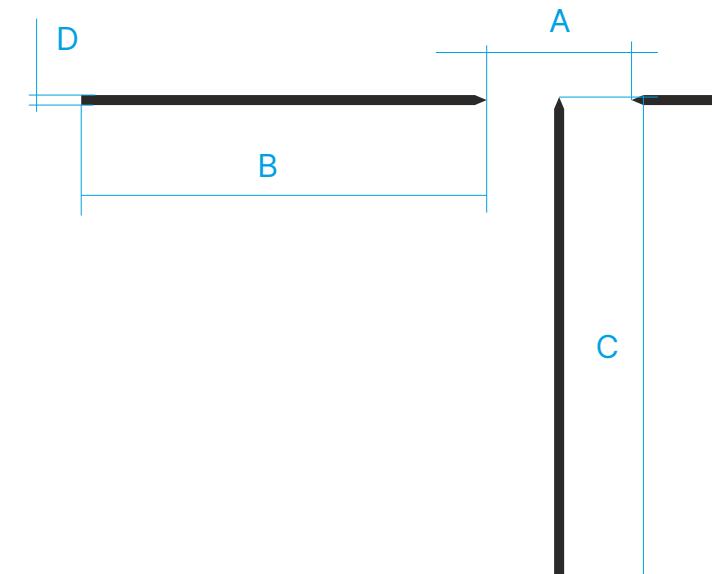

	MOA	cm @ 100 m
Section A	34.4	100
Section B	145	422
Section C	162	472
Section D	3.6	10.5


Thermal Imaging Riflescope

THERMION 2 LRF XG50


[TO CONTENT](#)



M58i

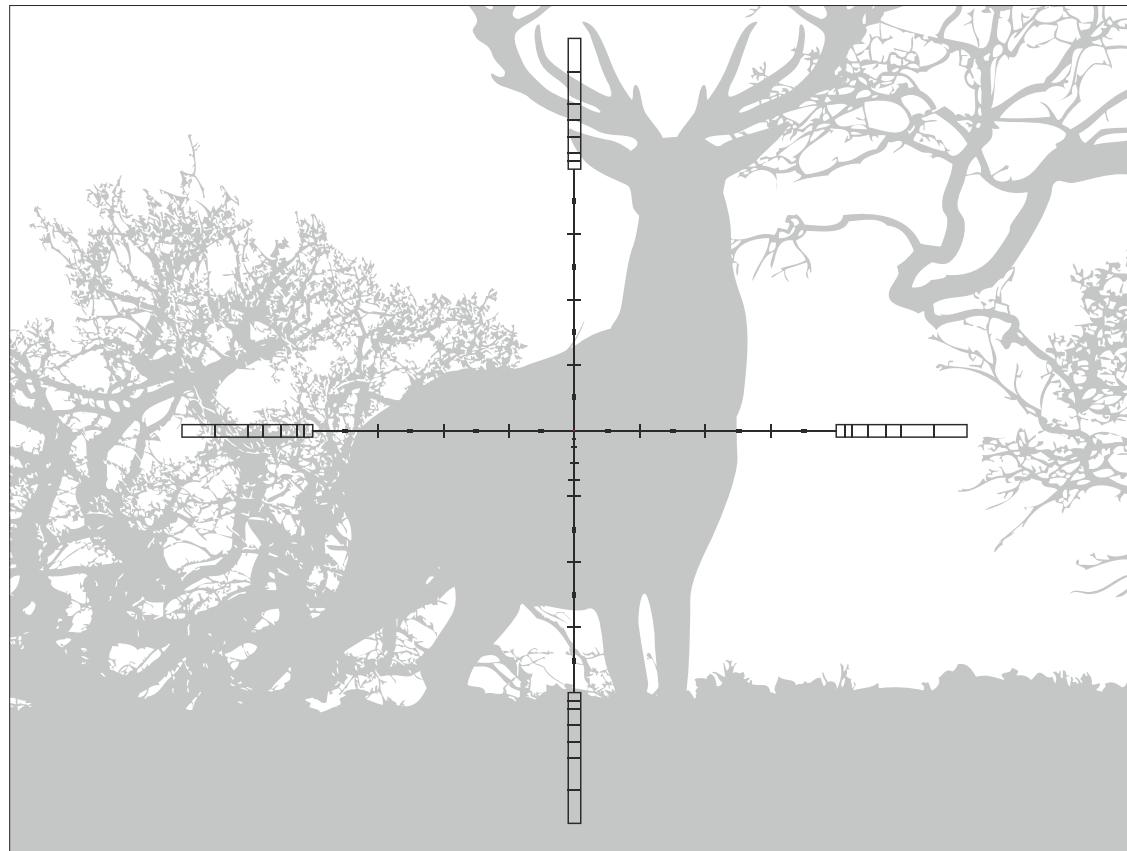

Reticle parameters
(for minimum magnification)

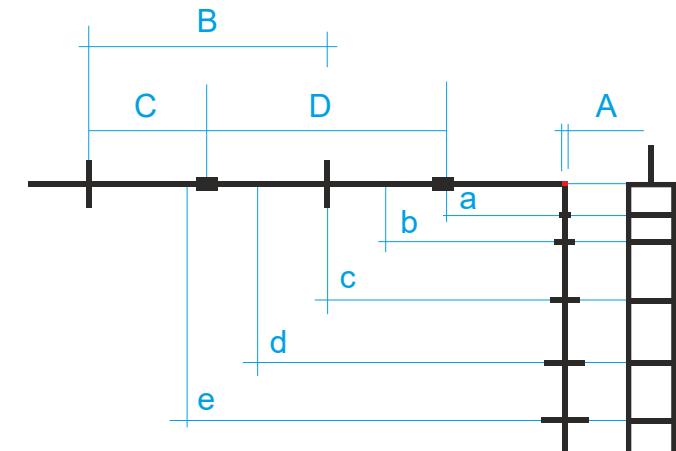

	MOA	cm @ 100 m
Section A	0.5	1.5 on 3x magnification
Section B	3.5	10 (1 mil) on 24x magnification
Section C	3.5	10 (1 mil) on 12x magnification
Section D	3.5	10 (1 mil) on 24x magnification

Section a	1 mil (10 cm @ 100 m) on 3x magnification
Section b	1 mil (10 cm @ 100 m) on 6x magnification
Section c	1 mil (10 cm @ 100 m) on 12x magnification
Section d	1 mil (10 cm @ 100 m) on 18x magnification
Section e	1 mil (10 cm @ 100 m) on 24x magnification

Thermal Imaging Riflescope


THERMION 2 LRF XG50

TO CONTENT




X51 Fi-300

SCALABLE

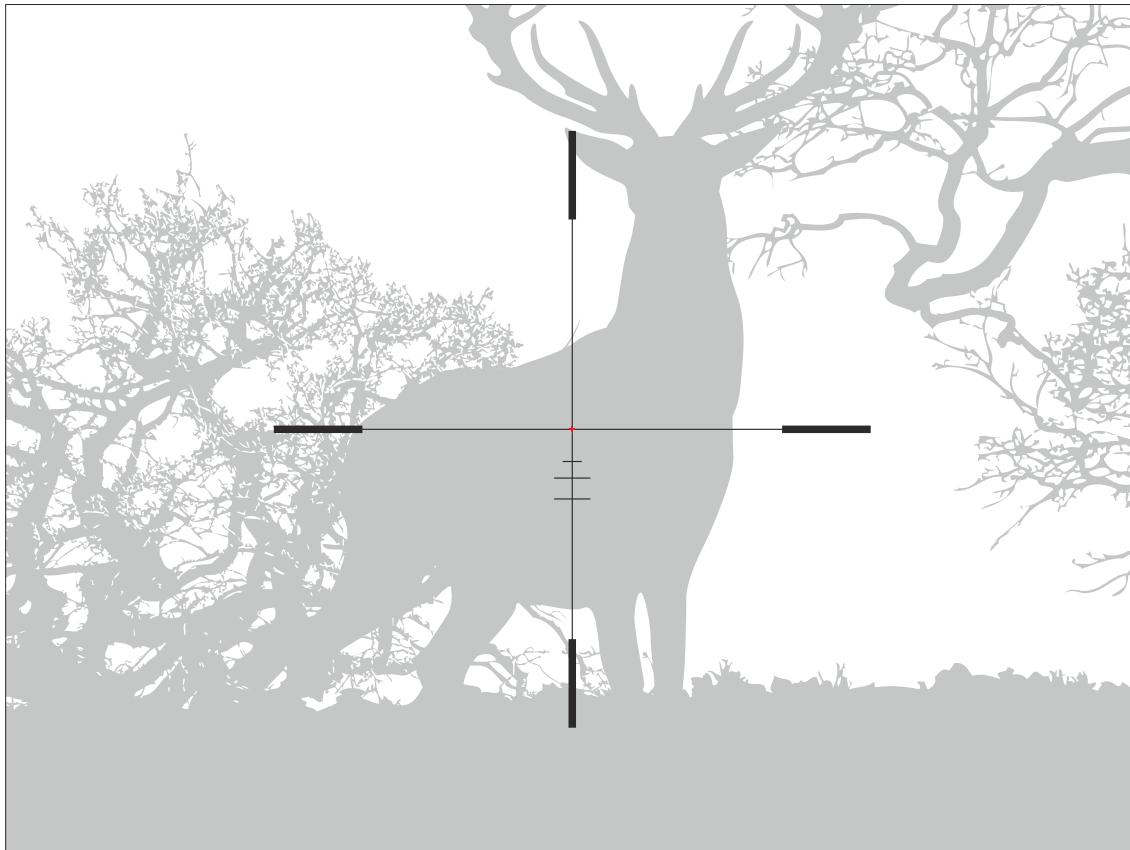

Reticle parameters
(apply to all magnifications)

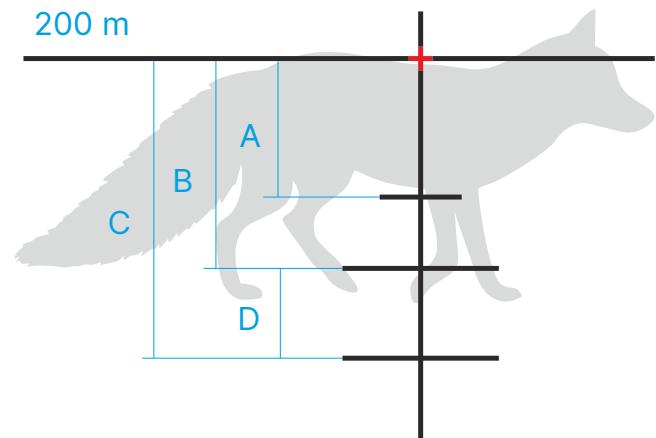

	200 m	300 m
Section A	15 cm (fox body)	23 cm (roe deer body)
Section B	23 cm (roe deer body)	35 cm (wild boar body)
Section C	35 cm (wild boar body)	50 cm (deer body)
Section D	—	15 cm (fox body)

Thermal Imaging Riflescope


THERMION 2 LRF XG50

TO CONTENT




M56Fi

SCALABLE

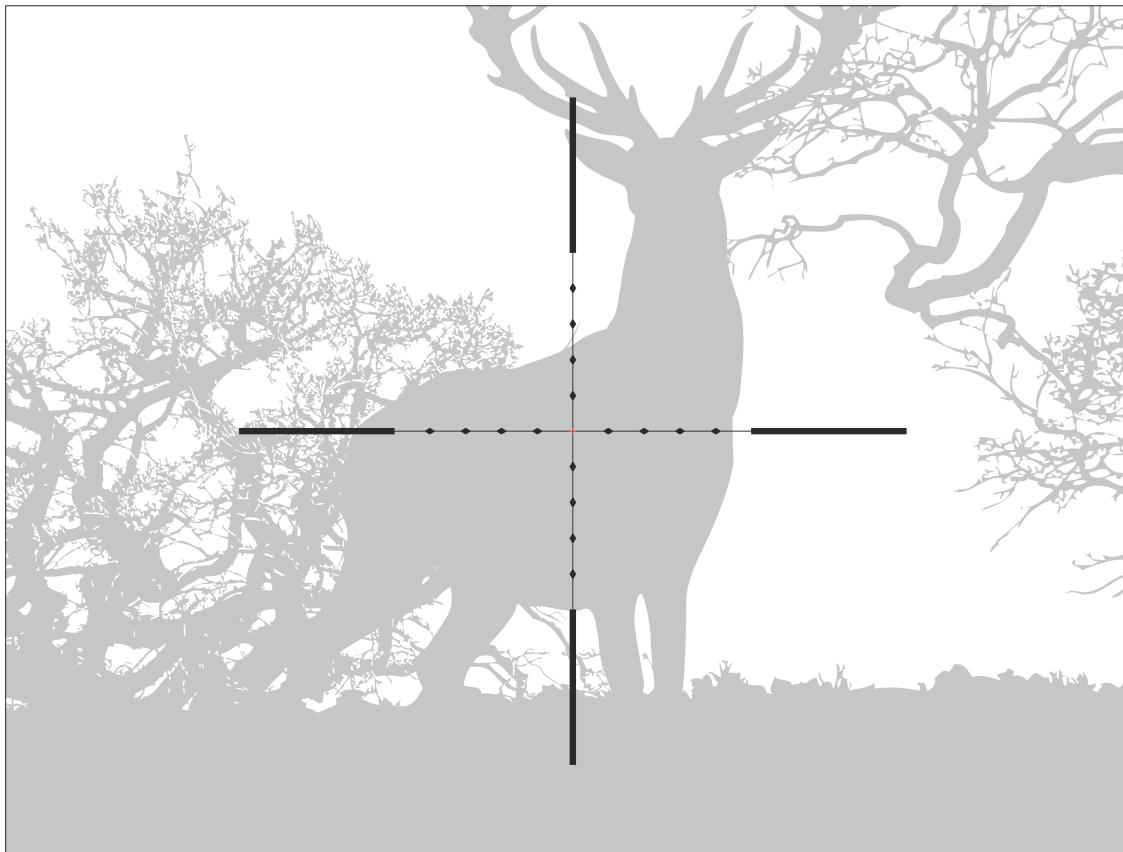

Reticle parameters
(apply to all magnifications)

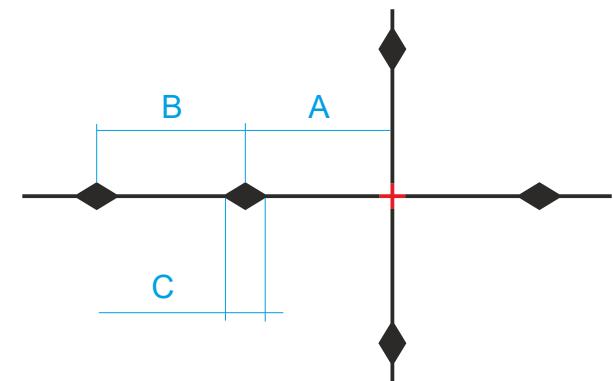

	MOA	CM @ 100 M
Section A	3.5	10 (1 MIL)
Section B	3.5	10 (1 MIL)
Section C	0.86	2.5 (0.25 MIL)

Thermal Imaging Riflescope

THERMION 2 LRF XG50

[TO CONTENT](#)




M57Fi

SCALABLE



Reticle parameters
(apply to all magnifications)

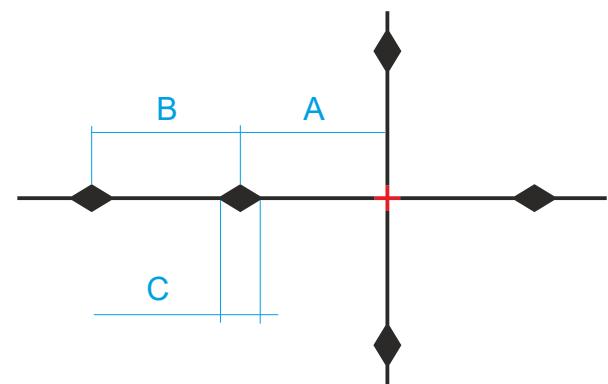

	MOA	CM @ 100 M
Section A	3.5	10 (1 MIL)
Section B	3.5	10 (1 MIL)
Section C	0.86	2.5 (0.25 MIL)

Thermal Imaging Riflescope

THERMION 2 LRF XG50

[TO CONTENT](#)



www.pulsar-vision.com